
KENNEDY VALVE



UL/FM Butterfly Valves





Designed for the Fire Protection Industry

Sizes: 2-1/2", 3", 4", 6", 8" 300 PSI Rated Double Seal Design For Bubble Tight Shut Off UL Listed and FM Approved Outdoor Rated

C.S.F.M. Listed

Light Weight Corrosion Resistant Fusion Bond Coating Low Torque Operation, High Cycle Life Easy to read Flag Type Position Indicator

KENNEDY VALVE


Division of McWane, Inc.

) us 1021 East Water St., Elmira, NY 14901 (607) 734-2211 🧹



Grooved End Butterfly Valves 2-1/2" to 8"

Figure G300 & 01G 300 psi with Supervisory Tamper Switch

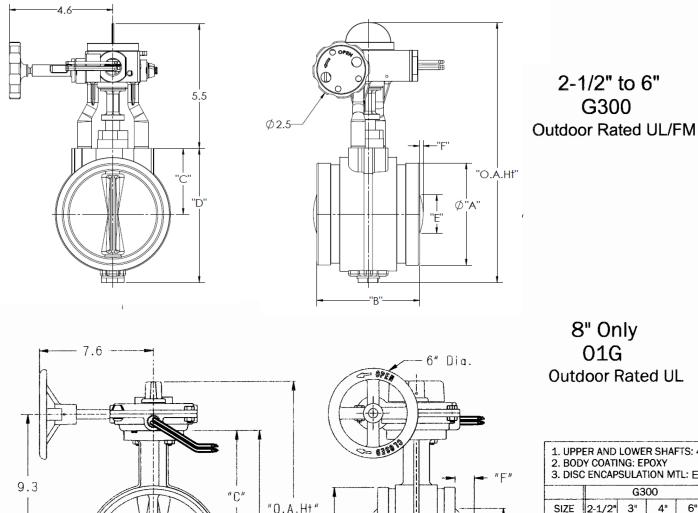

1. UPPER AND LOWER SHAFTS: 416 SS 2. BODY COATING: EPOXY 3. DISC ENCAPSULATION MTL: EPDM					
		G3	00		01G
SIZE	2-1/2"	3*	4ª	6"	8°
A	2.85	3.47	4.47	6.61	8.6
В	3.8	3.8	4.5	5.8	5.2
С	2.2	2.4	2.9	4.0	8.2
D	4.3	4.8	5.9	8.1	14.3
E	-	-	-	1.7	5.9
F	-	-	-	.1	1.3
O.A.Ht.	10.0	10.4	11.6	13.8	17.6
Wt.#	8.8	10.1	13.5	24.6	44

Note: "E" will be MINIMUM allowed pipe I.D. Exercise care handling and during installation.


"B"

Ø" A'

Kennedy Valve - UL/FM Butterfly Valves 11-2

" "

Updated 07/20/19

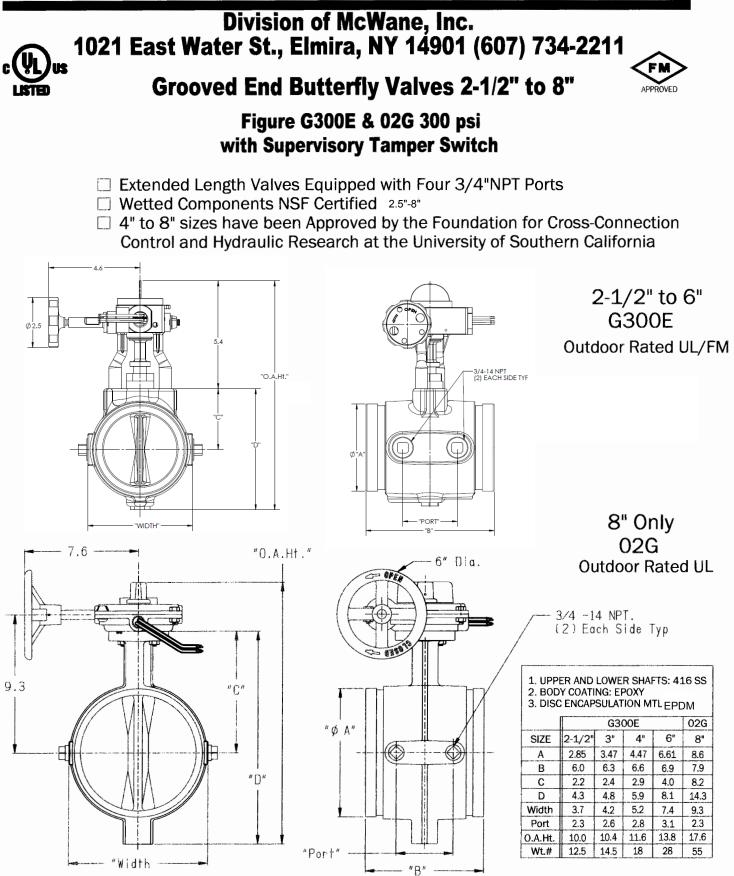

Note: Disc does not protrude past the "B" dimension of the body on any size in the open position. Exercise care handling and during installation.

Kennedy Valve - UL/FM Butterfly Valves 11-3

Updated 07/20/19


KENNEDY VALVE


Division of McWane, Inc. 1021 East Water St., Elmira, NY 14901 (607) 734-2211

Wafer Butterfly Valves 2-1/2" to 8"



Figure W300,W300I, & 01G 300 psi with Supervisory Tamper Switch





VALVE SELECTION FO	R ISO PN 16 FLANGE
FLANGE SIZE	KV MODEL
65 MM	2-1/2" W300
80 MM	100EW "E
100 MM	4" W300I
150 MM	6″ W300

2-1/2" to 6" W300 & W300I

Outdoor Rated UL/FM

W300I - ISU PN16 FLANGE 3*/80nn & 4*/100nn DNLY


> 8" Only 01W Outdoor Rated UL

1. UPPER AND LOWER SHAFTS: 416 SS 2. BODY COATING: EPOXY 3. DISC ENCAPSULATION MTL EPDM							
	1	W300, W300I 01W					
SIZE	2-1/2"	3"	4"	6ª	8"		
A	4.2	4.4	5.3	7.5	9.5		
В	1.8	1.8	2.0	2.2	2.4		
C	2.2	2.4	2.9	4.0	8.2		
D	4.3	4.8	5.9	8.1	14.3		
E	1.7	2.4	3.3	5.6	7.5		
F	.4	.6	.9	1.9	2.7		
O.A.Ht.	10.0	10.4	11.6	13.8	17.6		
Wt.#	10.5	11.1	13.8	20.5	44		

"E"

"B"

*Grooved flange washer not required when grooved flange adapter is used for install

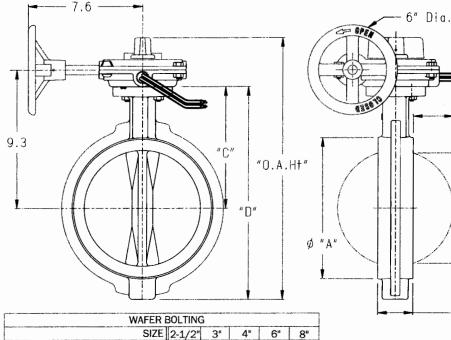

WAFER I	BOLTING	Э.			
SIZE	2-1/2"	3"	4"	6"	8"
Number of Studs	4	4	8	8	8
Stud size (inch)	5/8	5/8	5/8	3/4	3/4
Stud Length Min. (inch)	5.5	5.5	6.5	7	7.5
Recommended Min.Torque (Ft-Lbs	30	30	30	40	50
	·				

Dimensions B, D, and E are referenced in Installation Instructions. "E" is MINIMUM allowed pipe I.D.

Exercise care handling and during installation *

Kennedy Valve - UL/FM Butterfly Valves

11-4 Updated 07/20/19

BUTTERFLY VALVE - G300/G300E/W300/W300I/01G/01W/02G SUPPLEMENTARY INSTALLATION INSTRUCTIONS

Information shown here is intended to supplement, not replace, instructions that is shipped with each valve.

Dimensional information regarding minimum pipe I.D. and disc protrusion are shown on dimensional page for particular valve.

Exercise care handling and during assembly.

Grooved Body

For use with grooved end in steel pipe (IPS)

See valve dimensional information for min. pipe I.D. (dimension E) Valves shall be installed by person(s) certified to install grooved end fittings in a fire protection system by authority having jurisdiction.

1) Place gasket over pipe or fitting to which valve will be joined.

2) Position valve against mating pipe/fitting.

3) Slide gasket into position on valve and adjacent pipe/fitting and

install coupling according to coupling manufacturer's instructions.

Wafer Body

For installation between two ANSI B16.1, 125 lb. flanges

See valve dimensional information for min. pipe I.D. (dimension E) 1) Two flanged mating pieces should be placed at a distance apart that is slightly more than the thickness of the body (dimension B on wafer table)

2) A minimum of 2 studs shall be placed through adjacent flange holes so that the lower trunnion of the valve can fit between them. Normally this is the bottom 2 holes if the valve will be vertical with open/closed indicator on top.

3) Place the valve between the flanges taking care not to disturb the body gaskets.

4) Place remaining studs around the valve and tighten using an alternating pattern until desired torque is reached.

Switch Wiring

1) Valve has internal switches that operate from the OPEN position.

2) One switch has dual leads that is for connection to the SUPERVISORY circuit of an alarm panel. The other switch has single leads and is intended to be connected to AUXILIARY equipment.

3) Unused leads can be tucked into junction box (not provided)

4) Always comply with national codes, local codes, and NFPA 13, 71, and 72.

01G,01W, & 02G 8"			G300, G300E, W300, & W300I Sizes 2-1/2" to 6"				
Switch Supervisory Black From Listed Alarm Panel	Position Switch Black End of Line Device or Next Valve		Auxiliary Switch Black/ Red White		Switch Position Supervisory Switch Blue Brown From Listed Alarm Panel End of Line Device or Next Valve	Case Ground ↓	Auxiliary Switch Blue/ Brown Orange Orang
Blue	Blue	Green	Blue/ * White		Yellow	Green	⁴ Yellow Orang
Rated: 120 VAC, 28 VDC, .25 A				Rated: 120 VAC, 28 VDC, .25 A			
	*Normally closed valves FM Approved						

Kennedy Valve - UL/FM Butterfly Valves 11-5





www.kennedyalve.com 2019

1021 E Water St. Elmira, NY 14901 P.O. Box 981 Phone (607)734-2211 Fax: 1-800-952-4771

Updated 07/20/19